



STATE OF WASHINGTON
DEPARTMENT OF HEALTH
NORTHWEST DRINKING WATER REGIONAL OPERATIONS
20425 72nd Avenue South, Suite 310, Kent, Washington 98032

May 29, 2013

KELLY ROBINSON
DOCKTON WATER ASSOCIATION
9710 SW WINDMILL ST
VASHON WA 98070

Subject: Dockton Water Association System, ID # 19550
King County
Small Water System Management Program
Submittal 13-0317

Dear Mr. Robinson:

Thank you for submitting the above referenced planning document for the Dockton Water Association which was received in this office on March 20, 2013. We have completed our review and offer the following comments.

This is a very well done document! Our compliments.

1. Provide a short summary of existing facilities and how they operate in Section 1-2. Include information regarding existing sources, reservoirs, booster pump stations, control valves, distribution piping and treatment.
2. Continue to work on your Cross Connection Control Program and Wellhead Protection Program, both of which are required under WAC 246-290. Please keep the Department apprised of progress on the schedule submitted in Sections 1-4 and 1-5, respectively.
3. Update DOH contact information Section 1.6/3.
4. Update your coliform monitoring plan to include a map showing routine and repeat sampling locations. Also, clarify language for repeat samples. We would not recommend you sample the Sandy Shores Well if it has not been in use. Also, if you use the raw water sample at Dockton Springs as your 4th repeat sample, you might run the risk of getting a non-acute MCL violation. It might be better to take a fourth sample in the distribution system and mark your GWR sample as a 'raw'.




5. Incorporate Stage 2 DBP sampling requirements into 2-3.
6. Please address the issues contained in the April 4, 2013 letter from Department of Ecology.
7. Dockton's Annual water use efficiency reports for 2010 and 2011 report distribution system leakage of 26.6% and 21.3%, respectively. Have you initiated a water loss control action plan and are these activities included in your financial operating budget?
8. You may wish to consider including design and construction standards for distribution main replacements, given your capital improvement schedule (CIP) contains a number of main replacement projects. For any new projects not included in a previous or current CIP, you must submit a project report/construction documents to DOH for review and approval.

We hope that you have found these comments to be clear, constructive and helpful in the development of your final SWSMP. We ask that you submit the revised SWSMP on or before August 29, 2013.

Regulations establishing a schedule for fees for review of planning, engineering and construction documents have been adopted (WAC 246-290-990). Please note that we have included an invoice in the amount of \$510.00 for the review of the SWSMP. This fee covers our cost for review of the initial submittal, plus the review of one revised document. Please remit your complete payment in the form of a check or money order within thirty days of the date of this letter to: **DOH, Revenue Section, and P.O. Box 1099, Olympia, WA 98507-1099.**

Thank you again for submitting your revised SWSMP for our review. If you have any comments or questions concerning our review, please contact Paige Igoe at (253) 395-6764, or me at (253) 395-6771.

Sincerely,

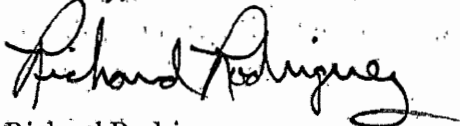

Richard Rodriguez
Regional Planner

Cc: Paige Igoe, DOH
Seattle/King Co. Health Dept.
Steve Hirschey, King Co. UTRC